

# **CHATCHAI**

## **SPECIFICATION**

### **OIL IMMERSED TRANSFORMER**

**100 KVA. 3 Ph. 50 Hz**

**33000 - 400 / 230 V.**

# CHATCHAI

## SPECIFICATION THREE PHASE TRANSFORMER

35/4 Moo 8 Tarmai Karthumbaen Samutsakhon

Tel. 085-2961053

### Transformer Specification

**Quote. Ref :**

**Customer :**

**Project :**

Rated power	.....KVA	<b>100</b>	
Type of transformer	-	<b>Oil immersed ( Hermetically sealed )</b>	
Standard	-	IEC 76	
Cooling System	-	ONAN	
No. Of phase	-	3	
Frequency	.....Hz	50	
Rate of voltage : Primary	.....V.	<b>33000</b>	
: Secondary	.....V.	<b>400/230</b>	
Vector group	-	Dyn 11	
Tapping Type	-	<b>Off Circuit Tap Changer</b>	
No. of steps	-	5	
Percentage of tapping	-	<u>+</u> 2 x 2.5 %	
Impedance voltage at 75 C	.....%	4	
NO - Load current	.....%	1	
Ambient temperature	.....C	40	
Average Temperature rise of winding	.....C	65	
Average Temperature rise of top oil	.....C	60	
Noise level not more than	.....dB	56	
No - Load loss	.....Watt	<b>250</b>	
Load loss at 75 C	.....Watt	<b>1550</b>	
Efficiency at P.F. = 1	: 25 % of rate power	.....%	98.94
	: 50 % of rate power	.....%	98.08
	: 75 % of rate power	.....%	98.79
	: 100 % of rate power	.....%	98.56
Voltage regulation	: at P.F. = 0.8	.....%	3.22
	: at P.F. = 0.9	.....%	2.71
	: at P.F. = 1.	.....%	1.17
Impulse Withstand Voltage	: Primary winding	.....KV.	125
	: Secondary winding	.....KV.	-
Power Frequency	: Primary winding	.....KV.	50
	: Secondary winding	.....KV.	3
Terminal arrangement H.V. Side		Cable	
L.V. Side		Cable	
Installation on		Pole mounted / Platform	

# CHATCHAI

## SPECIFICATION THREE PHASE TRANSFORMER

35/4 Moo 8 Tarmai Karthumbaen Samutsakhon

Tel. 085-2961053


### Transformer Specification

Quote. Ref :

Customer :

Project :

Rated power	100
Type of transformer	Oil immersed ( Hermetically sealed )
<b>Accessories</b>	
H.V. Bushing with terminal connector	Included
L.V. Bushing with terminal connector	Included
Grounding pad or earth terminal	Included
upper fillter press sampling valve	Included
Oil drain, filter press sampling valve	Included
Name plate	Included
Arcing Horn	Included
Skid Base	Included
Mechanical pressure relief device	Included ( without contact )
Oil level indicator	Included ( with contact )
	Included ( with contact )
	Included ( with contact )
<b>Testing</b>	
<b>- Routine test</b>	
Ratio test at each position of tap	Included
Polarity and phase relation test	Included
Resistance measurement	Included
No - Load loss and exciting current test	Included
Impedance and load loss test	Included
Applied potential test	Included
Induced potential test	Included
Insulation resistance test	Included
Oil test	Included
<b>- Specia test</b>	
Impulse withstand test	Included ( CHATCHAI lab )
Temperature rise test	Included ( CHATCHAI lab )

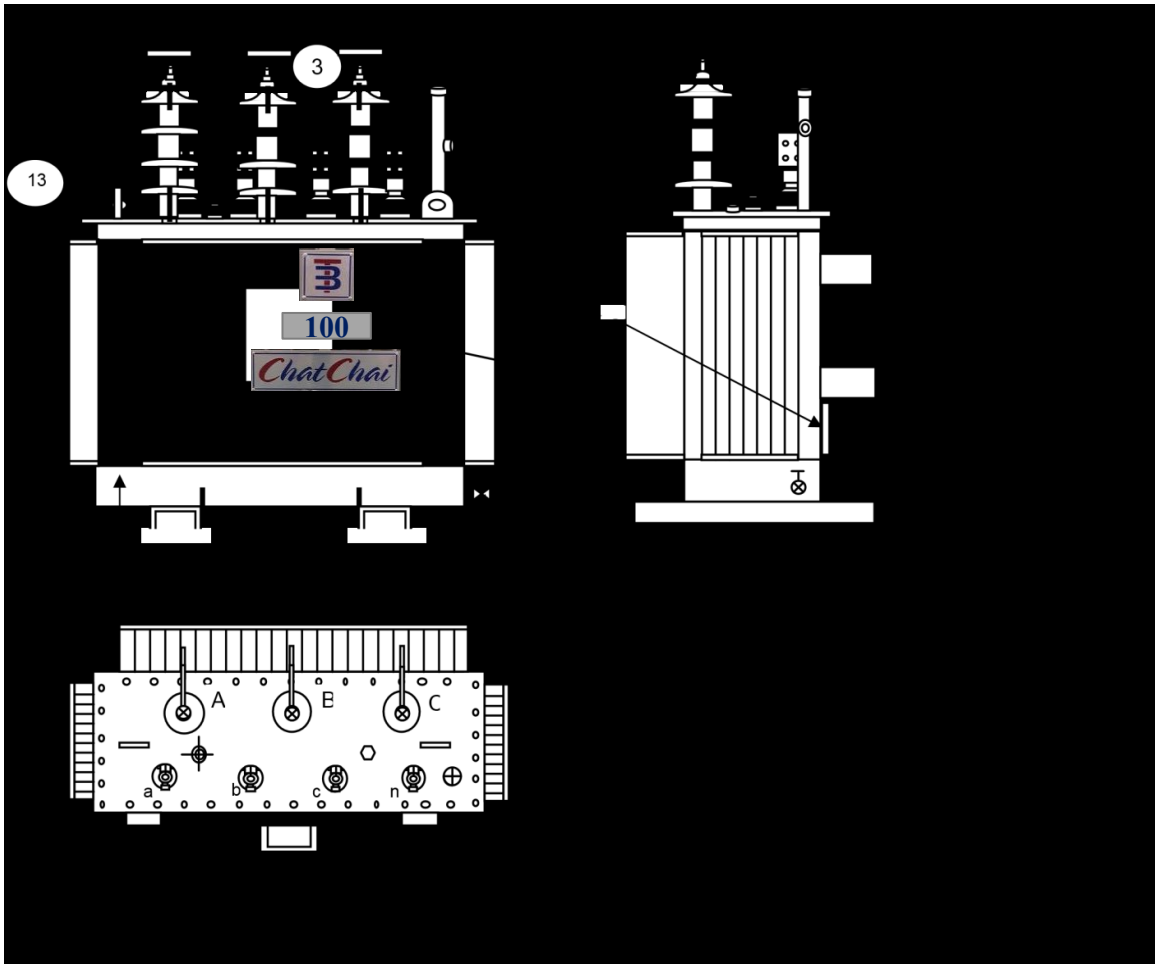

NO	DESCRIPTION
1	NAMEPLATE WITH CONNECTION DIAGRAM
2	HV. BUSHING W / TERMINAL CONNECTOR
3	LV. BUSHING W / TERMINAL CONNECTOR
4	TANK
5	TAP CHANGE
6	EARTH TERMINAL
7	OIL DRAIN VALAE
8	LIFTING EYES ON THE COVER
9	OIL LEVEL INDICATOR
10	OIL FILLING PIPE
11	OIL LEVEL GAUGE
12	LOGO
13	THERMOMETER POCKET