

CHATCHAI

SPECIFICATION
OIL IMMERSED TRANSFORMER
250 KVA. 3 Ph. 50 Hz
33000 - 400 / 230 V.



CHATCHAI TRANSFORMER CO.,LTD

35/4 หมู่ 8 ต. ท่าไม้ อ. กระทุ่มแบน จ. สมุทรสาคร

Tel. 085-2961053 085-3151766

T
C
C
P
ation

Rated powerKVA	250	
Type of transformer	-	Oil immersed (Hermetically sealed)	
Standard	-	IEC 76	
Cooling System	-	ONAN	
No. Of phase	-	3	
FrequencyHz	50	
Rate of voltage : PrimaryV.	33000	
: SecondaryV.	400/230	
Vector group	-	Dyn 11	
Tapping Type	-	Off circuit tap changer	
No. of steps	-	5	
Percentage of tapping	-	$\pm 2 \times 2.5 \%$	
Impedance voltage at 75 C%	4	
NO - Load current%	1	
Ambient temperatureC	40	
Average Temperature rise of windingC	65	
Average Temperature rise of top oilC	60	
Noise level not more thandB	56	
No - Load lossWatt	500	
Load loss at 75 CWatt	2950	
Efficiency at P.F. = 1	: 25 % of rate power%	98.94
	: 50 % of rate power%	98.08
	: 75 % of rate power%	98.79
	: 100 % of rate power%	98.56
Voltage regulation	: at P.F. = 0.8%	3.22
	: at P.F. = 0.9%	2.71
	: at P.F. = 1.%	1.17
Impulse Withstand Voltage	: Primary windingKV.	125
	: Secondary windingKV.	-
Power Frequency	: Primary windingKV.	50
	: Secondary windingKV.	3
Terminal arrangement H.V. Side			Cable
L.V. Side			Cable
Installation on			Pole mounted / Platform



CHATCHAI TRANSFORMER CO.,LED

35/4 หมู่8 ต. ท่าไม้ อ.กระทุ่มแบบ จ. สมุทรสาคร

Tel. 085-2961053 085-3151766



Tification

C

C

P

Rated power	250
Type of transformer	Oil immersed (Hermetically sealed)
Accessories	
H.V. Bushing with terminal connector	Included
L.V. Bushing with terminal connector	Included
Grounding pad or earth terminal	Included
upper fillter press sampling valve	Included
Oil drain, filter press sampling valve	Included
Name plate	Included
Arcing Horn	Included
Skid Base	Included
Mechanical pressure relief device	Included (without contact)
Oil level indicator	Included (with contact)
	Included (with contact)
	Included (with contact)
Testing	
- Routine test	
Ratio test at each position of tap	Included
Polarity and phase relation test	Included
Resistance measurement	Included
No - Load loss and exciting current test	Included
Impedance and load loss test	Included
Applied potential test	Included
Induced potential test	Included
Insulation resistance test	Included
Oil test	Included
- Specia test	
Impulse withstand test	Included (TR lab)
Temperature rise test	Included (TR lab)

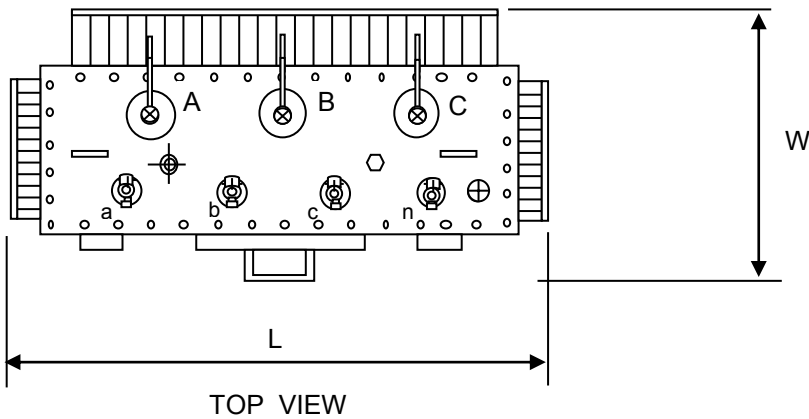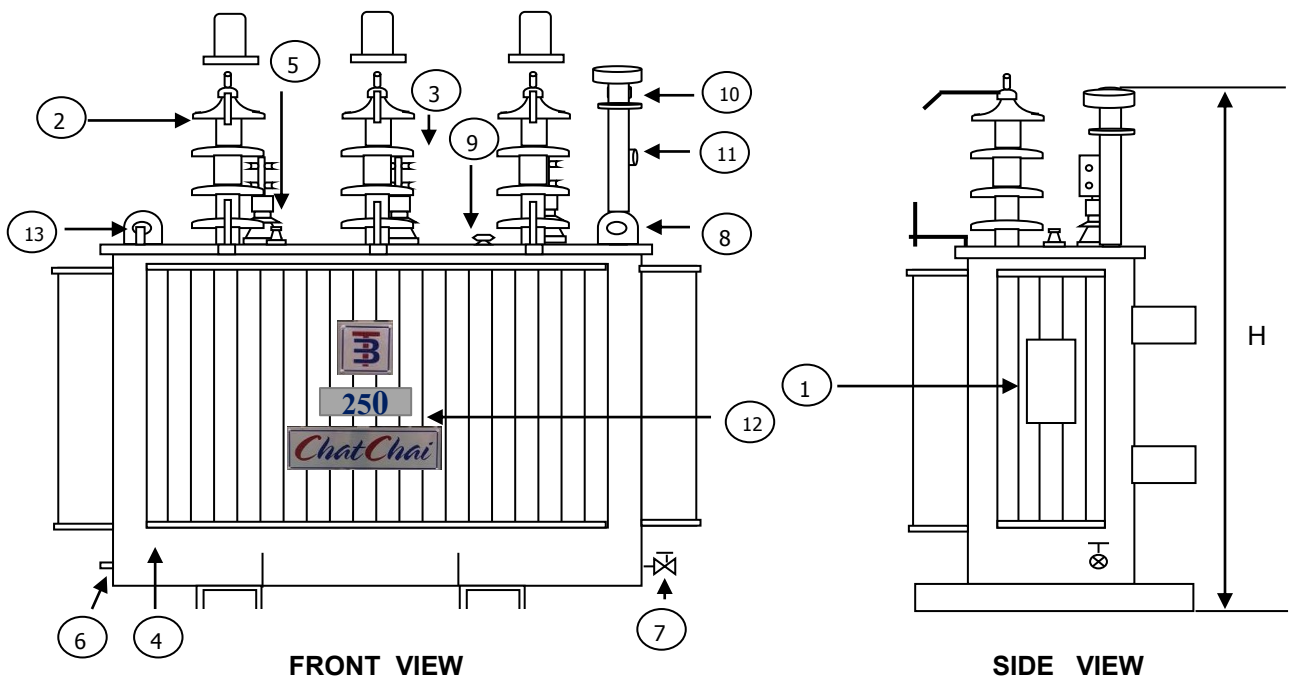

NO	DESCRIPTION	QTY.
1	NAMEPLATE WITH CONNECTION DIAGRAM	1
2	HV. BUSHING W / TERMINAL CONNECTOR	3
3	LV. BUSHING W / TERMINAL CONNECTOR	4
4	TANK	1
5	TAP CHANGE	1
6	EARTH TERMINAL	1
7	OIL DRAIN VALAE	1
8	LIFTING EYES ON THE COVER	2
9	OIL LEVEL INDICATOR	1
10	OIL FILLING PIPE	1
11	OIL LEVEL GAUGE	1
12	LOGO	1
13	THERMOMETER POCKET	1
14	ARCING HORN	3

CHATCHAI TRANSFORMER CO.,LTD.



Dimension in millimetres			Total wt.	Oil
H	L	W	(Kgs.)	(Litres)
1400 mm	1430 mm	750 mm	1180	300

DESIGN No. 00500TCT0009052 S/O No. A0009052

NAME	TITLE :	OUTLINE DRAWING
DRN.BY		250 KVA. 3 Ph. Dyn 11
CHK.BY		33000 - 400 / 230 V.
APP. BY		TYPE : Hermetically sealed tank

PRELIMINARY DRAWING

This drawing is for estimation only showing approximate dimensions and should not be used for actual purposes
In case of order a definite drawing will be produced for formal approval

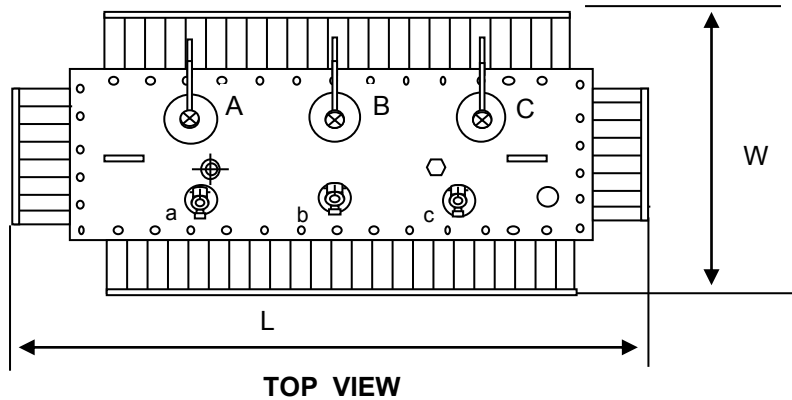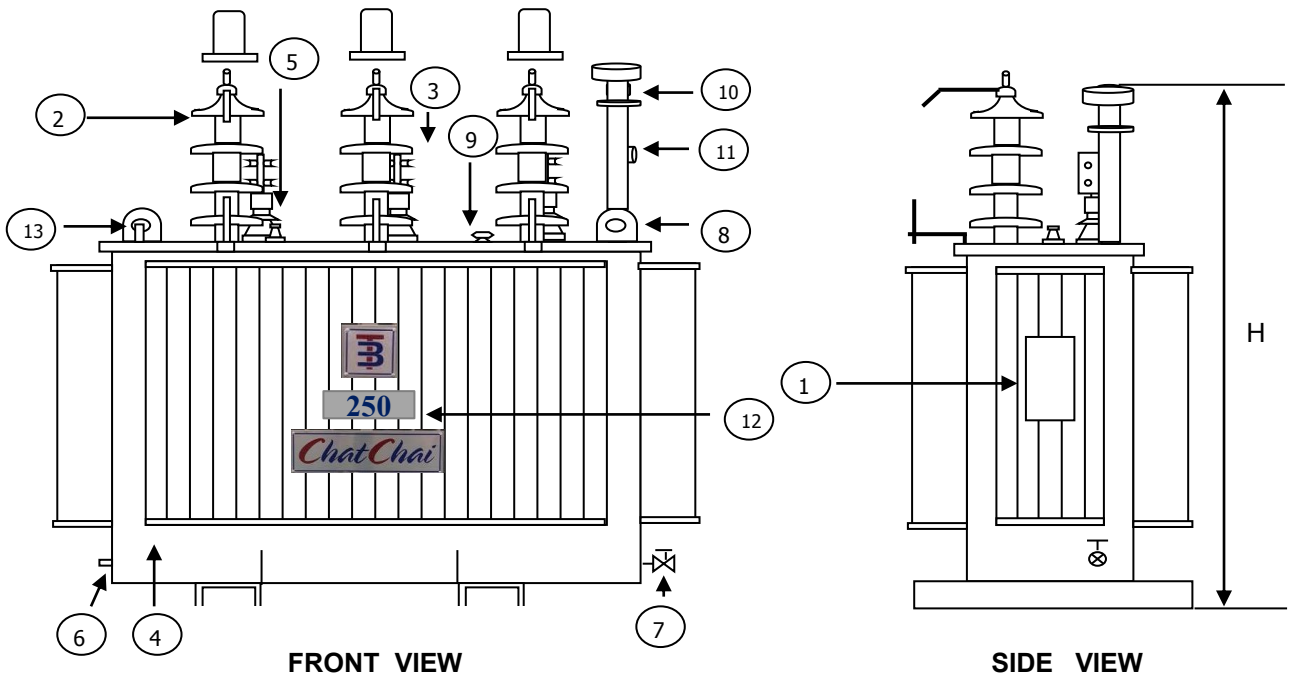

NO	DESCRIPTION	QTY.
1	NAMEPLATE WITH CONNECTION DIAGRAM	1
2	HV. BUSHING W / TERMINAL CONNECTOR	3
3	LV. BUSHING W / TERMINAL CONNECTOR	4
4	TANK	1
5	TAP CHANGE	1
6	EARTH TERMINAL	1
7	OIL DRAIN VALAE	1
8	LIFTING EYES ON THE COVER	2
9	OIL LEVEL INDICATOR	1
10	OIL FILLING PIPE	1
11	OIL LEVEL GAUGE	1
12	LOGO	1
13	THERMOMETER POCKET	1
14	ARCING HORN	3

T R Engineering Service Co.,Ltd					
Dimension in millimetres			Total wt.	Oil	
H	L	W	(Kgs.)	(Litres)	
1850 mm	1720 mm	950 mm	1280	330	
DESIGN No. 00500TCT0009052			S/O No. A0009052		
NAME			TITLE : OUTLINE DRAWING		
DRN.BY			250 KVA. 3 Ph. Dyn 11		
CHK.BY			33000 - 400 / 230 V.		
APP. BY			TYPE : Hermetical sealed tank		

PRELIMINARY DRAWING

This drawing is for estimation only showing approximate dimensions and should not be used for actual purposes
 In case of order a definite drawing will be produced for formal approval