

CHATCHAI

SPECIFICATION

OIL IMMERSED TRANSFORMER

400 KVA. 3 Ph. 50 Hz

24000 - 416 / 240 V.



CHATCHAI

SPECIFICATION THREE PHASE TRANSFORMER

31/2 Moo 8 Tarmai Karthumbaen Samutsakhon

Tel. 085-2961053


Ti Specification

Q1

C1

Pr

Rated powerKVA	400
Type of transformer	-	Oil immersed (CONSERVATOR TANK)
Standard	-	IEC 76
Cooling System	-	ONAN
No. Of phase	-	3
FrequencyHz	50
Rate of voltage : PrimaryV.	24000
: SecondaryV.	416/240
Vector group	-	Dyn 11
Tapping Type	-	Off Circuit Tap Changer
No. of steps	-	5
Percentage of tapping	-	$\pm 2 \times 2.5 \%$
Impedance voltage at 75 C%	4
NO - Load current%	1
Ambient temperatureC	40
Average Temperature rise of windingC	65
Average Temperature rise of top oilC	60
Noise level not more thandB	56
No - Load lossWatt	720
Load loss at 75 CWatt	4150
Efficiency : 25 % of rate power%	98.94
: 50 % of rate power%	98.08
at P.F. = 1 : 75 % of rate power%	98.79
: 100 % of rate power%	98.56
Voltage regulation : at P.F. = 0.8%	3.22
: at P.F. = 0.9%	2.71
: at P.F. = 1.%	1.17
Impulse Withstand : Primary windingKV.	125
Voltage : Secondary windingKV.	-
Power Frequency : Primary windingKV.	50
: Secondary windingKV.	3
Terminal arrangement H.V. Side		Cable
L.V. Side		Cable
Installation on		Pole mounted / Plantform



CHATCHAI

SPECIFICATION THREE PHASE TRANSFORMER

31/2 Moo 8 Tarmai Karthumbaen Samutsakhon

Tel. 085-2961053


Tr cification

Qu

Customer .

Project :

Rated power	400
Type of transformer	Oil immersed (CONSERVATOR TANK)
Accessories	
H.V. Bushing with terminal connector	Included
L.V. Bushing with terminal connector	Included
Grounding pad or earth terminal	Included
upper fillter press sampling valve	Included
Oil drain, filter press sampling valve	Included
Name plate	Included
Arcing Horn	Included
Skid Base	Included
Mechanical pressure relief device	Included (without contact)
Oil level indicator	Included (with contact)
	Included (with contact)
	Included (with contact)
Testing	
- Routine test	
Ratio test at each position of tap	Included
Polarity and phase relation test	Included
Resistance measurement	Included
No - Load loss and exciting current test	Included
Impedance and load loss test	Included
Applied potential test	Included
Induced potential test	Included
Insulation resistance test	Included
Oil test	Included
- Specia test	
Impulse withstand test	Included (CHAT CHAI lab)
Temperature rise test	Included (CHAT CHAI lab)

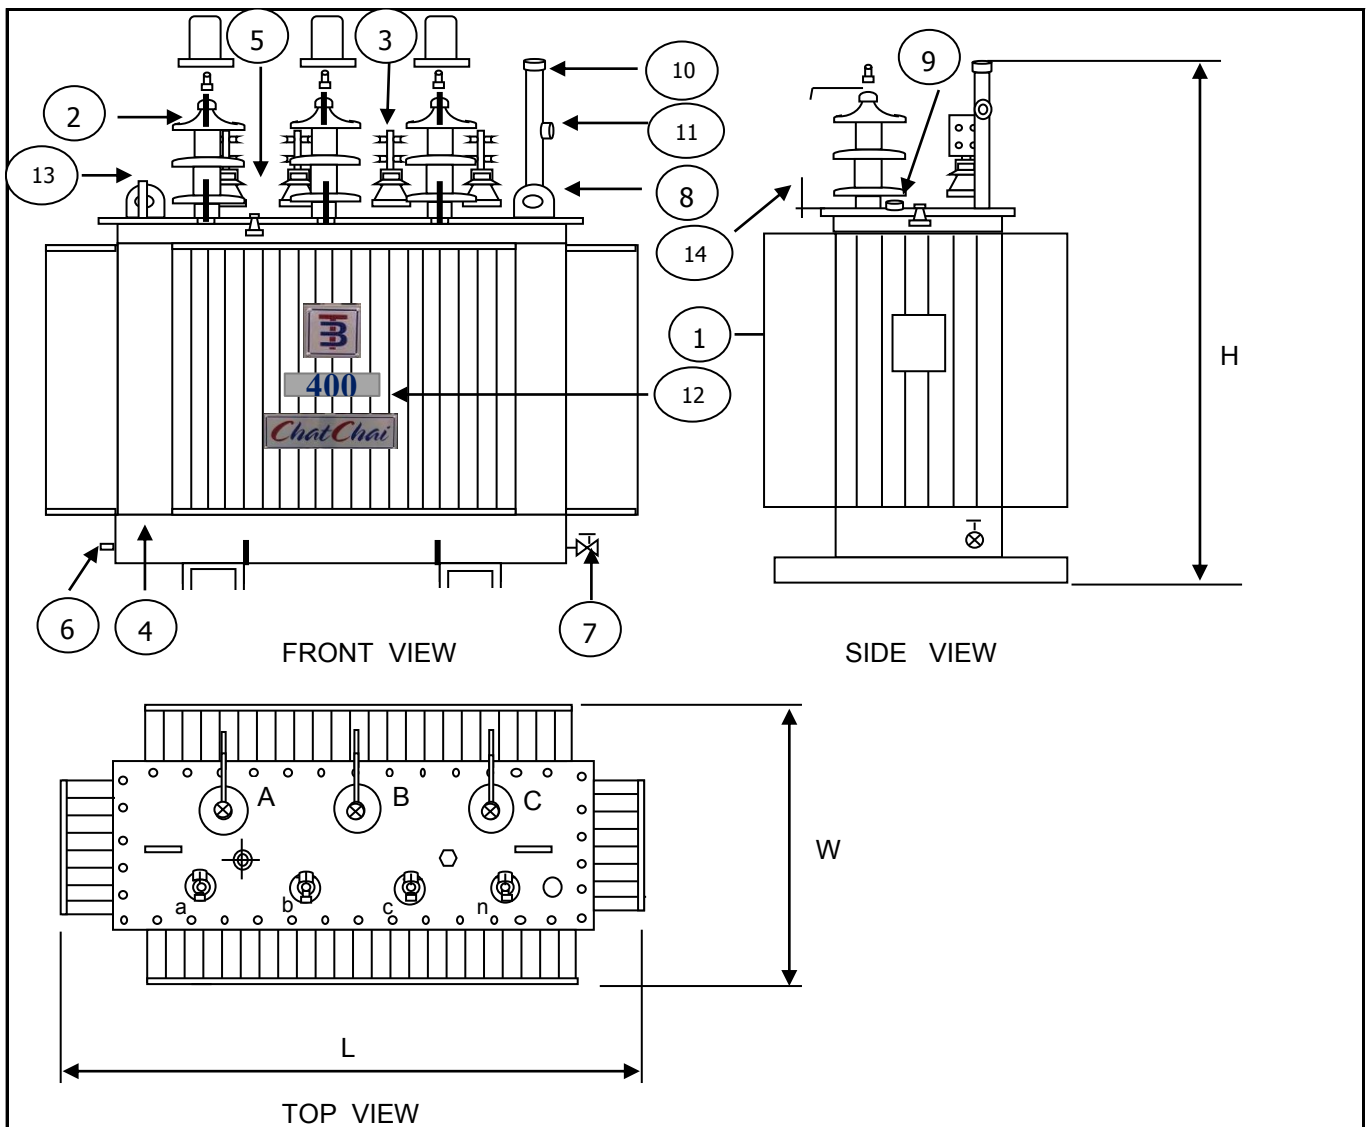

NO	DESCRIPTION	QTY.
1	NAMEPLATE WITH CONNECTION DIAGRAM	1
2	HV. BUSHING W / TERMINAL CONNECTOR	3
3	LV. BUSHING W / TERMINAL CONNECTOR	4
4	TANK	1
5	TAP CHANGE	1
6	EARTH TERMINAL	1
7	OIL DRAIN VALVE	1
8	LIFTING EYES ON THE COVER	2
9	OIL LEVEL INDICATOR	1
10	OIL FILLING PIPE	1
11	OIL LEVEL GAUGE	1
12	LOGO	1
13	THERMOMETER POCKET	1
14	ARCING HORN	3

CHATCHAI					
Dimension in millimetres				Total wt.	Oil
	H	L	W	(Kgs.)	(Litres)
	1670 mm	1560 mm	815 mm	1550	425
DESIGN No. 001TR40022000				S/O No.	A001056
NAME			TITLE :	OUTLINE DRAWING	
DRN.BY				400 kVA. 3 Ph. Dyn11	
CHK.BY				24000 - 416 / 240	
APP. BY			TYPE : Hermetically sealed tank		

PRELIMINARY DRAWING

This drawing is for estimation only showing approximate dimensions and should not be used for actual purposes
In case of order a definite drawing will be produced for formal approval